
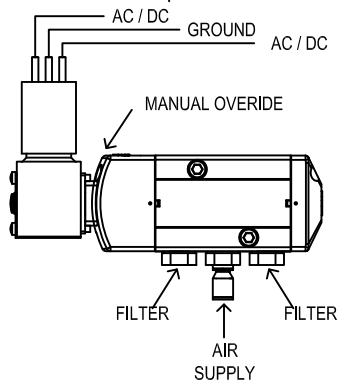
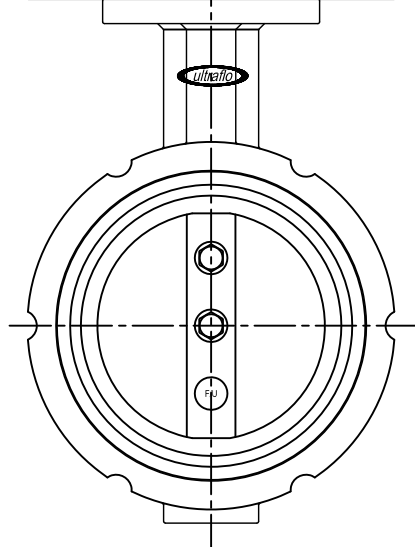


ATTENTION PLEASE CHECK THE ULTRAFLO WEBSITE AT www.ultraflovalve.com TO ENSURE YOU HAVE THE MOST RECENT COPY OF THIS DOCUMENT

PNEUMATIC ACTUATOR MOUNTING

PERPENDICULAR




PO=Fail Open
PC=Fail Closed
PA=Double Acting

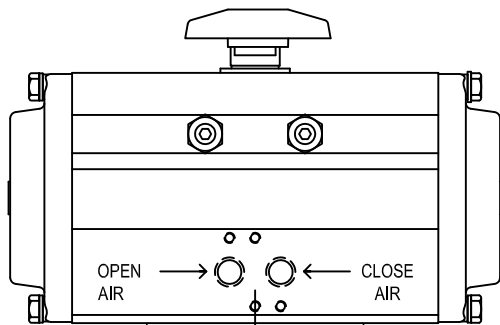


ULTRAFLO RECOMMENDS THE USE OF FILTERS ON NON-PLUMBED SOLENOID
AND ACTUATOR AIR PORTS

STANDARD

FO=Fail Open
FC=Fail Closed
DA= Double Acting

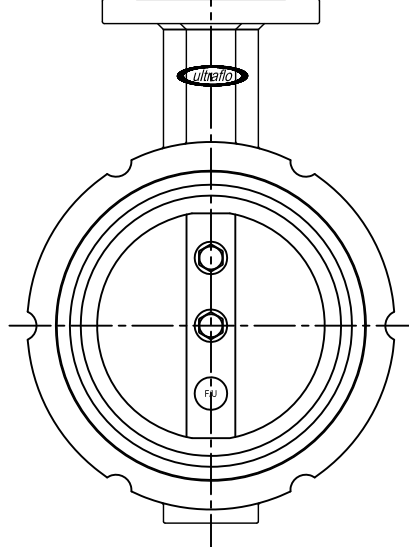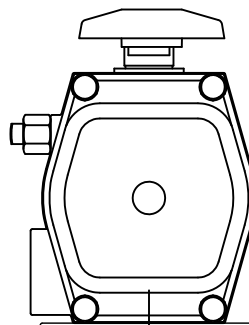

DOUBLE ACTING USE 5/2 PLATE
SPRING RETURN USE 3/2 PLATE

ZONE	REV	DATE	BY	APP'D	ECN	DESCRIPTION	<div> Ultraflo Corporation A Subsidiary of Bray International, Inc.</div>			#8 Trautman Ind. Dr. Ste. Genevieve, Mo. 63670 800-950-1762
								NAME	DATE	100 SERIES ACTUATOR
						DRAWN BY	CJH	02/12/13		
						CHECKED	CJH	02/12/13		
						PART: 100 SERIES PNEUMATIC ACTUATOR INFORMATION				
							ECN: 692		DWG: 100-2	